

The Suitability of River Benue and CHANCHAGA Sand as Filter Media

H. E. Jijingi^{1*}, A. M. Ezekiel² and T. Adumbu³

^{1,2}Department of Soil Science and Land Resources Management, Federal University Wukari, P.M.B 1020,
Wukari Taraba State – Nigeria

³Department of Agriculture and Bio-Environmental Engineering Technology, Federal College of Agriculture
Ishiagu Ebonyi State-Nigeria

Abstract: This study was aimed at discovering the local sand media sources establishing their physical, chemical properties and performance in a pilot filtration plant. The sand from River Benue and River CHANCHAGA in North central Nigeria were used in this study and subjected to various soil mechanics and hydraulic tests. The results showed that, the sands from the rivers have effective sizes (E_s) of 0.35 mm and 0.42 mm; Uniformity coefficient (U_c) of 1.43 and 1.31; Specific gravity of 2.67 and 2.54; Porosity (%) of 42 and 47; Permeability (Cm/Sec) of 4.7×10^{-1} and 2.4×10^{-1} for river Benue and CHANCHAGA, respectively. However, Brazil sand had effective sizes (E_s) of 0.46 mm; Uniformity coefficient (U_c) of 1.48; Porosity (%) of 45; Specific gravity of 2.60; Permeability (Cm/Sec) of 3.5×10^{-1} while the chemical properties showed that Rivers Benue and CHANCHAGA had acid solubility of (1.05 and 1.70) %, respectively. The analysed Brazil sand had acid solubility of 0.85 %. However, backwash rate of 45.9 m/hr attributed to expansion rate of River Benue (25.83 %), River CHANCHAGA (26.67 %) and Brazil sand (22.50 %). At the end of the study, River Benue and River CHANCHAGA sand have suitable properties which are recommended for filter media.

Keywords: Backwashing, CHANCHAGA Sand, Filtration, Hydraulic Tests and River Benue

I. Introduction

The need for water treatment to have potable water for the rural dwellers is highly important and need to be emphasised. The rural settings of developing countries like Nigeria, are associated with a number of problems; namely: unlimited capital resources with nearly unlimited demand for capital; lack of appropriate technology to suit the prevailing conditions; the cost and availability of power, materials and labour is in reverse order; shortage of skilled and trained personnel; inadequate facilities for repairs and maintenance etc.

Sand filtration is an integral part of most drinking water treatment facilities. This includes both large technologically advanced treatment plants serving relatively affluent urban areas and small plants serving poor communities in relatively isolated rural areas. Sand filtration is usually the final (and in some cases the only) particle removal step in the water treatment and plays a critical role in safeguarding the macro and micro particulate quality of the finished water as well as in reducing disinfectant requirement [1].

Water filtration is a physical process for separating colloidal impurities from water by passage through a porous medium, usually a bed of sand or other granular material like rice husk, gravel and anthracite [2]. As water percolates slowly through the filter medium (Sand), natural physical, biological and chemical processes combine to provide treatment.

Among the various unit operations of a conventional water treatment plant, filtration occupies a central and important place and perhaps the oldest and most widely used in the water purification treatment [3].

When using sand as a filter medium, composition, size, uniformity and depth of the medium all affect the sand filter performance. Characteristics of the media composition, such as its solubility, acidity, and hardness, must be considered in the filter design. It is extremely important that the medium be washed. The media component should be inspected for cleanliness and suitability by a qualified individual before it is used in the filter. The media grains are sorted and sieved through a series of mechanical sieves. The grains must be relatively uniform in size to prevent clogging. "Effective size" and "uniformity coefficient" are measurements used to express these characteristics. Each sand filter type has its own particle size range requirements. Uniformity coefficient of four or less is recommended for all filter media [4].

II. Theoretical Background

This section examines the theory guiding the experiments needed to be conducted and their relevance to the study for a better understanding of principles and interpretation of data.

2.1 Particle size analysis

The particle size analysis of a soil sample involves determining the percentage by weight of particles within the different size ranges. The particle size distribution of a coarse grained soil can be determined by the method of sieving. A representative sample of the sample of the sand is split systematically down to a convenient sub-sample and then oven-dried. The sample is then passed through a series of standard test sieves arranged in descending order of mesh size.

2.1.1 Effective Particle Size

The effective size (ES) is defined by the size of screen opening where 90 % of a sample of granular media is retained on the screen and 10 % passes through the screen, and is referred to as D_{10} [5].

2.1.2 Uniformity Coefficient

The uniformity coefficient (U_c) is a numeric estimate of how sand is graded, and is a dimensionless number, in other words it has no units. The term “graded” relates to where the concentrations of sand particles are related by size [6]. Sand with all the particles in two size ranges would be defined as narrowly graded sand and would have a low U_c . Sand with near equal proportions in all the fractions would be defined as widely graded sand and would have a high U_c value. The U_c is calculated by dividing D_{60} (the size of screen opening where 60 % of sample passes and 40 % is retained) by D_{10} (the effective particle size- that size of screen opening where 10 % of the sample passes and 90 % is retained) [7].

2.2 Specific Gravity

Specific density is mass per unit grain volume, and is important because it affects the backwash flow requirements of the medium. The grain density is measured or determined from the specific gravity following ASTM standard test C128-84 specific gravity and absorption of the fine aggregate, using the displacement technique [8].

The density of granular materials does not directly affect performance of filter media, but it provides vital information that is required for the backwashing behaviour of the filter grains [9].

Specific gravity is the ratio of the mass of a body to the mass of an equal volume of water at a temperature of 23°C [7].

[10] recommended that filter media should have a specific gravity of not less than 2.5 and a hydrochloric acid solubility of less than 2 %.

2.3 Acid solubility

Acid solubility is used to express the proportion of carbonates or Hydrogen carbonates in the sample (River Sands). Sand cannot be affected to any appreciable (or noticeable) extent by acids because it is mainly SiO_2 compound. When soaked in an acid a change in the weight of the sand is usually noticed in minutes. Any high or noticeable change in the weight of sand raise doubts about its purity as this suggests that the change in the weight is a representation of the impurities which cannot be mechanically removed by washing but are now either dissolved or burnt by the acid. Therefore, a sand sample that has a large solubility value is not good for filter medium as acids are usually formed in water. A method recommended by [11] was adapted in the determination of the acid solubility of the sand samples.

2.4 Porosity

Porosity is defined as the pore volume per unit filter volume. It is a useful measure for its acid test ensures the integrity of the grains. Porosity of soil material is a major factor in determining the flow through such materials. This flow through a porous medium is a common phenomenon occurring in groundwater flow, seepage and infiltration; dewatering of slurries and sludge in industries; clarification of industrial liquids, sewage treatment and water purification. [9] reported that the practical range of filter porosities lies between 0.35 - 0.50. This however, may vary during the filter run and during the backwash process when it can drop to about 0.1 or rise to about 0.8. He also reported that a typical porosity value for sand media is about 0.45.

2.5 Permeability

Permeability test was determined using the Constant head test of [12]. The permeability was measured by the constant head method, using the I C W laboratory permeameter (Eiji Kelkamp Agrisearch No. 09 02). The permeability concept is a characteristic of both fluid and the porous media. A number of appropriate empirical relationships have been suggested between permeability K and other soil properties.

2.6 Filterability

Deep beds of porous granular media are in widespread use in municipal and industrial practice to filter liquids to improve their clarity. Prominent among these uses is the filtration of drinking water and industrial water, although the filtration of sewage as a tertiary stage of treatment is increasing. Filterability is not a property of just suspension, but is an interactive property between a suspension and some filter media. If the properties of one of these say a standard medium is kept constant then changes in the filterable if it can pass rapidly through a porous medium, giving a clear filtrate with little clogging of filter medium clogging is reflected in the loss of permeability, as seen in the increase in pressure drop. A simple measure of whether the liquid is filterable is useful, to enable assessment of whether filtration is an appropriate process, and if so what type of pre-treatments and filter medium required. Although the normal methods of chemical and physical analysis may with experience indicate whether a suspension may be filtered, they give no direct measures of this property. The early researchers as reported by [13] have proposed a number of measures of filterability.

III. Methodology (Materials And Methods)

3.1 Site description (Study Area)

(a) River Benue

River Benue in West African, originated from Northern Cameroon and flowing West across Nigeria, lies on latitude $7^{\circ}33'00''N - 7^{\circ}57'00''N$ and longitude $8^{\circ}21'00''E - 8^{\circ}39'00''E$ and is the chief tributary of River Niger of length 1400 km. The river divides the state capital into two; the North and South banks which are connected by two bridges: the railway bridge and the dual carriage way bridge as shown in Fig. 3.1

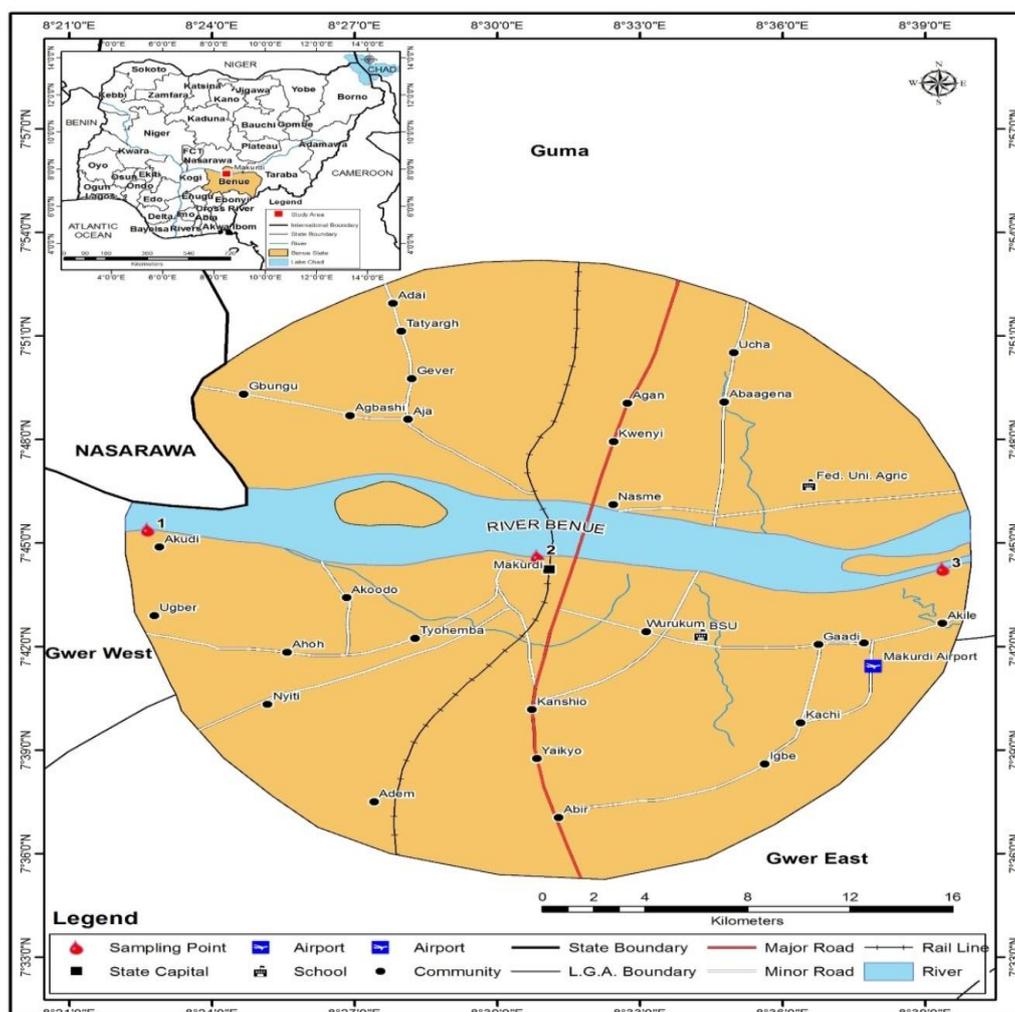


Figure 3.1: Map of Makurdi LGA showing River Benue with sample collection points

Source: Adapted and modified from Administrative map of Benue State 2014.

(b) River CHANCHAGA

Minna the state capital of Niger State is the headquarters of CHANCHAGA Local Government Area. The River CHANCHAGA is located between latitude 09° 34' 00" N - 09° 42' 00" N and longitude 06° 29' 00" E - 06° 35' 00" E in the Local Government Area. The river has tributaries from River Gora and River Tagwai and originated from River Niger as shown in Fig. 3.2

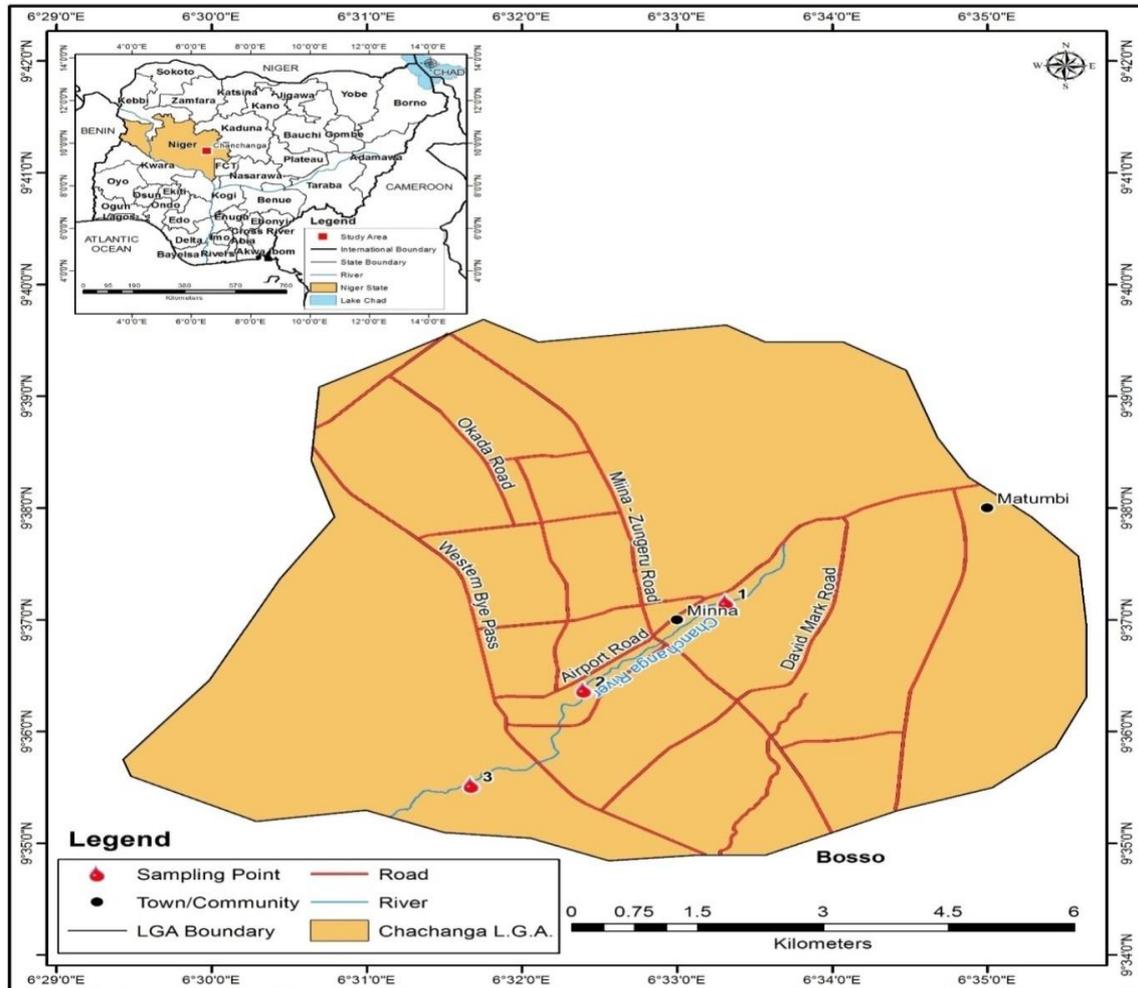


Figure 3.2: Map of CHANCHAGA LGA showing River CHANCHAGA with sample collection points
 Source: Adapted and modified from Administrative map of Niger State 2014

3.2 Sample collection and preparation

Two (2) sand samples for the study were collected from the two Rivers describe Makurdi and CHANCHAGA. Samples were collected at three locations (Sample Points) with their co-ordinates shown in Table 3.1. From the top of the river bank, the bed of the rivers and at depth of 2½ meters from the river banks with a shovel into porous sacks, so as to allow the water to drain easily. These were mixed together as composite samples (Stocks). The collected sand samples were thoroughly washed to remove all organic materials, dirt and rubbish that may be present in the sand samples.

The sand samples were packed in sacks after washing for dewatering, after which they were removed from the sacks and spread on a clean surface for sun drying. After drying the samples were stored in sacks.

Table 3.1: River Sands Showing Sample Collection Points and Co-ordinates

River Sands	Sample Points	Co-ordinates
Benue	1	7°46'9.07" N 8°22'41.10" E
	2	7°44'48.27" N 8°30'48.91" E
	3	7°44'14.80" N 8°39'22.20" E
CHANCHAGA	1	9°37'9.25" N 6°33'18.51" E
	2	9°36'22.09" N 6°32'23.44" E
	3	9°35'31.31" N 6°31'40.28" E

The following equipment/Materials were used in carrying out this study,

(a) Equipment

1. Complete set of Sieves (Standard British Series)
2. Hot Air Oven (Gallenkamp, BRIT.No.882942 ENGLAND)
3. Electronic weighing balance, G & G, J.J 3000Gallenkamp Ltd
4. Mettler analytical balance capable of weighing accuracy ± 0.01 gram, Mettler P160N
5. Stop watch, HF Instrument, New York,USA.
6. Funnel (100 mm), Boro Silicate 24/20 England
7. Buckets (Plastic), 20liters, OK plastic Nigeria Ltd.
8. Filter paper, Whatman No 41 Water pump, 1.5hp Peter's pump, Germany
9. Pipes (PVC), Geepee Nigeria Ltd.
10. Flow meter and Control valves, Gallenkamp Products, England
11. Hand glove, C456, Agary Limited, Malaysia
12. Head pans, John.C, 24/36mm. England
13. Sacks, Dangote Sacks, 50kg, Nigeria.
14. Shovel, John.C, Size 14, England
15. Rubber Gasket and hose (Flexible pipe of 20cm)
16. Brass Mesh
17. Stand-pipe glass (Burette, 20c^{m3}) England
18. ICW laboratory permeameter (Eiji kerkamp Agrisearch No. 09 02)
19. Global Positioning System (GPS).
20. Filter beds
21. Graded and prepared sand from various sources.
22. Water pump, 1.5hp Peter's pump, Germany
23. Pipes (PVC), Geepee Nigeria Ltd.
24. Flow meter and Control valves, Gallenkamp Products, England

The following glasswares was used in carrying out this study,

(b) Glassware

1. Measuring cylinder, Kinax USA (100 ml, 200 ml and 250 ml capacity)
2. Glass beakers, Boro-Slicate England (100 ml and 200 ml capacity)
3. Thermometer, 110°C, Gallenkamp England
4. Crucible dishes, BS 34267, Gallenkamp England.
5. Specific gravity bottles, Technico-England.

The following reagents was used in carrying out this study,

(a) Reagents

Sulphuric acid (H₂SO₄) and hydrochloric acid (HCL), BDH Pool Limited England and Aluminium Sulphate

3.3 Determination of Particle Size Distribution

These parameters was determined by sieve analysis using the method of the American Society Testing and Materials [7] in which 500 grams of sand sample was sieved using standard sieves series (Apertures 4.760mm, 2.36mm, 2.00 mm, 0.600 mm, 0.425 mm, 0.300 mm, 0.212mm, 0.150 mm and 0.075 mm).The sieves were arranged in decreasing sieve bore size from top to bottom as listed above. The weight of sand retained on each sieve was determined using the electronic weighing balance and the percentage by weight, passing through each sieve was determined and this was plotted against sieve size on a semi-logarithmic paper. The sieve size that permits 10 % by weight of the sand sample, to pass through (as interpolated from the plot on the semi-logarithmic paper) gives the Effective size (**Es**) of the sand sample. Similarly, the sieve that permits 60 % of the sand sample by weight, to pass through was obtained. The uniformity coefficient (**Uc**) of the sand sample was then determined [14] using the relationship below;

$$\text{Uniformity coefficient (Uc)} = \frac{d_{60}}{d_{10}} \tag{3.1}$$

$$\text{Percentage passing (\%)} = \frac{100(W_1 - W_2)}{W_1} \tag{3.2}$$

Where

W₁ is the initial weight of the sand

W₂ is the retain weight of the sand

d₁₀ is the sieve sizes that pass 10% of the medium

d₆₀ is the sieve sizes that pass 60% of the medium [14].

The percentage useable, too fine or too coarse filter media for a given effective size and uniformity coefficient are computed as:

The percentage usable (P_u), from $d_u = 2 (d_{60} - d_{10})$

The percentage fine (P_f), $d_f = d_{10} - 0.2 (d_{60} - d_{10})$

The percentage Coarse (P_c), from $d_u = d_{10} + 1.8 (d_{60} - d_{10})$

3.4 Specific Gravity Determination

Specific gravity is mass per unit volume and is important because it affects the backwash flow requirements for the medium. It is determined using American Society Testing and Materials [15].

The weight (W_1) of specific gravity bottle was determined. The specific gravity bottle was filled with sand sample and combined weighted (W_2) determined. The specific gravity bottle with the sand sample was then filled with water and weight (W_3). The water in the specific gravity bottle was drained. Water was filled in the specific gravity bottle weighed to give (W_4).

The Specific gravity was then calculated using the formula in equation 3.4, developed by [16]

$$\text{Specific gravity} = \frac{W_2 - W_1}{(W_4 - W_1) - (W_3 - W_2)} \quad (3.3)$$

3.5 Acid Solubility

Acid solubility is used to express the proportion of carbonates or Hydrogen carbonates in the sample. A method recommended by [11] was adapted in the determination of the acid solubility of the soil sample. Four hundred (400) grams of sand sample were taken from the washed stock and recorded (W_1). The weighed sample was then immersed in 40 % (by volume) of hydrochloric acid (HCL) + 60 % distilled water for 24 hours (1 day) in a plastic bucket, to dissolve any organic matter present in the sample. The sample was then filtered with the aid of filter paper and funnel to collect the residue (sand sample). The residue collected were properly rinsed with distilled water, oven dried for 2 hrs at 105 °C and weighed (W_2) to determine the loss in weight.

The percentage Solubility was then calculated as follows:

$$\% \text{ Solubility} = \frac{W_1 - W_2}{W_1} \times 100 \quad (3.4)$$

Where:

W_1 = Initial weight of sand sample

W_2 = Final weight of sand sample

$W_1 - W_2$ = Loss in weight of sand sample

3.6 Determination of Porosity

Porosity (n) is the ratio of void volume to the total bed volume, expressed as a decimal, fraction or percentage. It affects the backwash flow required, the fixed bed head loss, and the solid holding capacity of the medium. The porosity was determined in accordance with ([14], [12]).

A transparent tube of 38 mm and 750 mm was half-filled with water. 150 g of sand sample was weighed and placed in the tube. Air and dirt was removed from the sand sample by shaking the tube. The dirty water in the transparent tube was decanted and the process was repeated until the sand sample is clean as evidenced by the quality of decanted water. The transparent tube was then filled with water and stopper with a cork, which was kept tight. The tube and its contents were supported by means of a clamp on a retort stand. The tube was agitated by inversion and allowed to settle freely in the water with no compaction or undisturbed. After settling, the level of sand in the tube column was then measured immediately, using a scale rule, after the last particles were observed to have settled. The volume (V) of the settled sand was then computed from the height of the sand in the column and the diameter of the tube.

Porosity of the sand was calculated as follows:

$$\text{Porosity (\%)} = \frac{\text{Volums of Void}}{\text{Total Volums}} \quad (3.5a)$$

$$n (\%) = \frac{v - w/\gamma}{v} \times 100 \quad (3.5b)$$

Where:

γ is the specific gravity of sand sample.

w is the mass of sand sample used.

V is the volume of the settled sand in the column.

3.7 Permeability Determination

Permeability test was determined using the Constant head test of [12]. The permeability was measured by the constant head method, using the I C W laboratory permeameter (Eiji Kelkamp Agrisearch No. 09 02). The equipment operates on the principle that water is cause to flow through a saturated sand column of know length (**L**) by the pressure difference on both sides of a well saturated sand sample.

The caps from the ring of known area (**A**) were removed and the samples were saturated overnight in a basin of water, this was done by covering the blunt end of the ring with a piece of nylon cloth which was held in place by means of a rubber band, to disallow soil loss. A specially meshed container was used to hold the ring which was in turn, placed inside a plastic container. The container containing the sample was then inserted into the permeameter after establishing a constant head. A tube previously filled with water was used as a junction connecting the inside of the ring holder and the water in the permeameter. This ensured flow of water into a burette. The time (**T**) taken at which a conveniently chosen volume (**V**) is attained in the burette is taken using a stop watch. The hydraulic height difference (**DH**) of water inside the ring holder and outside was measured and the permeability (hydraulic conductivity) (**K**) was calculated as follows;

$$K = \frac{V \cdot L}{A \cdot T \cdot (DH)} \quad (3.6)$$

Where,

K = Permeability (cm/sec)

V = Volume of water collected (cm^3)

L = Length of sand column (cm)

A = Cross sectional area of the sample (equivalent to area of core ring) cm^2

T = Time (Sec).

DH = Hydraulic head difference (cm).

Sand sample were treated as cohesion less soil in the permeameter.

3.8 Filterability Determination

The filtration effectiveness of the sand as filter medium was determined using the filterability test.

(a) Preliminary Treatment of Raw Water

In order to provide various level of initial turbidity for the filter operation and also to reduce the turbidity loading on the filters, preliminary experiments were carried out with jar-test apparatus to determine optimum alum dosage and optimum time for rapid and slow mix [17].

A 20 gram per litre stock solution of coagulant was prepared by dissolving 20 g of coagulant (aluminium sulphate $Al_2(SO_4)_3 \cdot 18H_2O$) in a litre of distilled water. This solution was added to each of the 1000 ml raw water sample from river Benue by varying the quantities to give different coagulant doses of 0.25, 0.5, 0.75, 1.0, 1.25 and 1.5 g/l [18]. The samples were stirred rapidly (rapid mix) for a period of 1 minute after which the stirring speed was reduced and stirring continued slowly for another 15 minutes. The coagulated water was allowed to settle for 27 minute [11]. Settle water samples were analysed for turbidity reduction and to obtain the optimum coagulant dose.

(b) Filtration experiment

Experimental Set-up

In setting up the experimental set up as shown in Fig. 3.3 in order to investigate the filter beds (sands) used, these consist of a column 100 mm in diameter and 2.8 m in height. Sampling points were made across the lower end of the column for a distance of 120 cm at various intervals. Pipes were installed from the sampling point to the sampling containers. Reading of the effluent flow rate and effluent turbidity were measured at various time intervals.

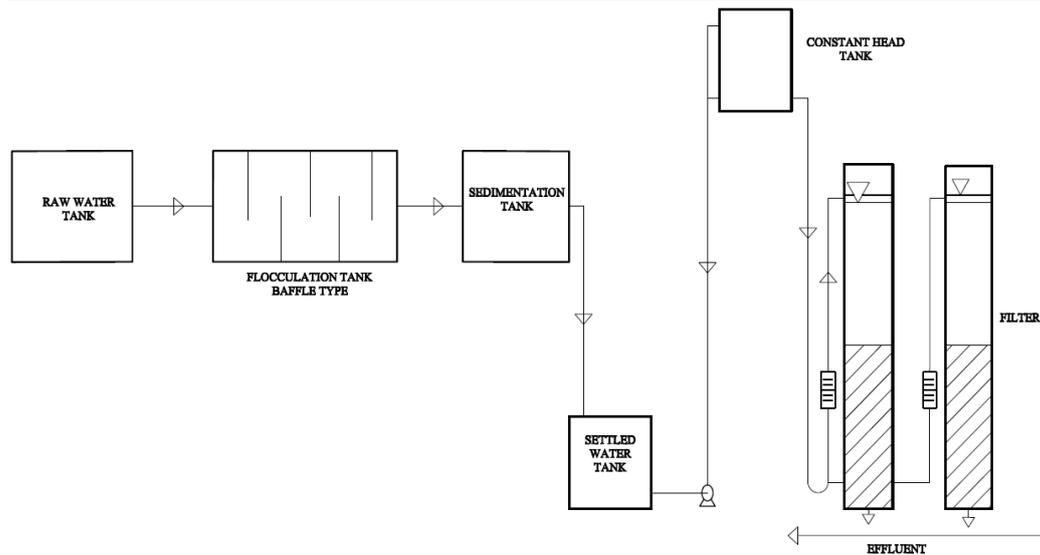


Figure 3.3: Schematic Diagram of Filtration Plant

• **Experimental Method**

Preparing the filter bed for the filter run involved filling the column with already graded and prepared sand. The depths of the filter beds inside the column were 120 cm.

Raw water from river Benue, which had been subjected to pre-treatment to attain required constant initial turbidity from the settle water tank was pumped into the overhead plastic bucket from which it was fed in to the filtration column via gravity. The rate of filling up the column was constantly maintained by a control valve and the inflow rate was maintained by flow meter. The primary variables investigated were; inflow rate, effluent flow rate, effluent turbidity as a function of time, bed depth and initial turbidity. The pressure drop across the filter beds was determined using modified Darcy - Wiesbach equations of head loss in pipe to reflect conditions in bed of porous media. The resulting equation 3.7, known as the Carmen-Kozeny modified equation [19].

$$h_f = \frac{f' L (1 - e) v_f^2}{e^3 g d_p} \tag{3.7}$$

Where:

h_f = Friction loss through bed of particles of uniform size,

L = depth of the filter, m

e = porosity of bed

v_f = Filtering velocity, i.e the velocity of the water just above the bed
(total flow Q to the filter divided by the area of the filter), m/s

g = gravitational acceleration, m/s^2

d_p = Diameter of filter media grains

The remaining term f' is a friction factor related to the coefficient of drag around the particle. In the usual range of filter velocities (laminar flow) and can be calculated by

$$f' = 150 \frac{(1 - e)}{R_e} + 1.75 \tag{3.8}$$

Where:

$$\text{Reynolds number } (R_e) = \frac{\phi \rho_w v_f d}{\mu} \tag{3.8a}$$

And ρ_w and μ are the density and dynamic viscosity, respectively, of water. The units of ρ_w are kilograms per cubic meter (kg/m^3), and the units of μ are Newton-seconds per square meter ($N.s/m^2$). The shape factor ϕ ranges from 0.75 – 0.85 for most filter media [19].

Filtrate thus collected was monitored for turbidity until it deteriorated to unacceptable levels when this happened; the filters were taken out of operation and backwashed at a rate of 45.9 m/hr. This rate is near the lowest recommended backwash rate 37 m/hr according to [20]. Filter bed expansion at this rate was measured by recording the height of expanded filter bed and finding the increase in height as a percentage of bed expansion during backwashing.

(b) Turbidity Determination

The turbidity of the filtrates was obtained by standardizing the turbidity meter and reading the turbidity values of the water directly from the turbidity meter in accordance with manufacturer’s instructions [21]. Turbidity was recorded in Nephelometric Turbidity Unit (NTU) [22].

IV. Results and Discussions

4.1 Particle Size Distribution

Details of particle size distribution of Rivers Benue, CHANCHAGA and Imported sand from Brazil are presented in Tables 4.1, 4.2 and 4.3 respectively. The Fig. 4.1, 4.2 and 4.3 of the particle size distribution of the various river sands and the imported sand from Brazil are presented at Appendix A showing the Sands effective size D_{10} of 0.35 mm, 0.42 mm and 0.46 mm respectively, while the sieve allowing 60 % of the sample to pass through (D_{60}) was 0.50 mm, 0.55 mm and 0.68 mm respectively. The Uniformity Coefficients (U_c) which are the ratio of D_{60}/D_{10} are 1.43, 1.31 and 1.48 respectively.

Table 4.1: Particle Size Distribution of River Benue Sand

Sieve Sizes (mm)	Mass Retained (g)	% Mass Retained	Cumulative Mass Retained	% Passing
4.760	0	0	0	100
2.360	26.70	5.34	5.34	94.66
2.000	16.10	3.22	8.56	91.44
0.600	82.20	16.44	25.00	75.00
0.425	275.30	55.06	80.06	19.94
0.300	61.60	12.32	92.38	7.62
0.212	20.10	4.02	96.40	3.60
0.150	6.60	1.32	97.72	2.28
0.075	3.20	0.64	98.36	1.64

Table 4.2: Particle Size Distribution of River CHANCHAGA Sand

Sieve Sizes (mm)	Mass Retained (g)	% Mass Retained	Cumulative Mass Retained	% Passing
4.760	0	0	0	100
2.360	11.10	2.22	2.22	97.78
2.000	13.80	2.76	4.98	95.02
0.600	141.10	28.22	33.20	66.80
0.425	302.90	60.58	93.78	6.22
0.300	16.60	3.32	97.10	2.90
0.212	5.90	1.18	98.28	1.72
0.150	2.00	0.40	98.68	1.32
0.075	1.30	0.26	98.94	1.06

Table 4.3: Particle Size Distribution of Imported Sand

Sieve Sizes (mm)	Mass Retained (g)	% Mass Retained	Cumulative Mass Retained	% Passing
4.760	0	0	0	100
2.360	12.10	2.42	2.42	97.58
2.000	14.80	2.96	5.38	94.62
0.600	142.20	28.44	33.82	66.18
0.425	305.10	61.02	94.84	5.16
0.300	18.30	3.66	98.50	1.50
0.212	3.50	0.70	99.20	0.80
0.150	2.40	0.48	99.68	0.32
0.075	0.30	0.06	99.74	0.26

4.1.1 Useful Portions as Filter Media

Table 4.4 shows the portions of stock sand that were too fine (P_F), Useable (P_U) and Coarse P_C as filter medium when graded to the values of uniformity coefficients and effective sizes as presented at Appendix A. The table also shows corresponding portion’s that would be obtained if sand samples were graded to recommended values of effective sizes of (0.50 mm) and uniformity coefficient (1.50).

Table 4.4: Fine, Useable and Coarse Portion of Stock Sand.

River Benue Sand.	Effective size (D_{10})	Uniformity Coefficient	Fine portion (P_f) %	Useable Portion (P_U) %	Coarse Portion (P_C) %
Determined Values	0.35	1.43	12	48	76
Typical Values	0.50	1.50	18	56	84
River CHANCHAGA Sand					
Determined Values	0.42	1.31	6	29	68
Typical Values	0.50	1.50	8	42	82
Imported Sand					
Determined Values	0.46	1.47	8	32	78
Typical Values	0.50	1.50	10	42	81

4.2 Acid Solubility

Table 4.5 presents the acid solubility of the river sands and that of the imported sand from Brazil, the hydraulic acid solubility result shows that river Benue sand and CHANCHAGA and Imported sand had acid solubility of 1.05 %, 1.70 % and 0.85 % respectively.

Table 4.5: Acid Solubility

River Benue Sand	Description	Weight (g)
	Initial Weight of Sand Sample	400
	Final Weight of Sand Sample	395.80
	Loss in Weight of Sand Sample	4.20
	% Solubility	1.05
River CHANCHAGA Sand		
	Initial Weight of Sand Sample	400
	Final Weight of Sand Sample	393.20
	Loss in Weight of Sand Sample	6.80
	% Solubility	1.70
Imported Sand		
	Initial Weight of Sand Sample	400
	Final Weight of Sand Sample	396.6
	Loss in Weight of Sand Sample	3.4
	% Solubility	0.85

4.3 Specific Gravity

The average specific gravity for each of the samples are presented in Table 4.7a - 4.7c shows the specific gravity of river sands from Benue, CHANCHAGA and that of the imported sand with specific gravities of 2.67, 2.54 and 2.60 respectively. Sands from river Benue, CHANCHAGA and the imported sand are within the recommended value (> 2.50) to be used as filter media because of the densities of all samples are higher than that of water.

Table 4.7a: Specific Gravity of River Benue Sand

Bottle No.	4	5	2	Average
Wt. of bottle + water (full) (W4)	96.60	94.00	89.70	93.43
Wt. of bottle + Soil + water (W3)	102.00	99.60	95.20	98.93
Wt. of bottle + Soil (W2)	55.70	53.40	49.00	52.70
Wt. of bottle (W1)	46.90	44.50	40.20	43.87
Wt. of Addition of Water (W4 - W1)	49.70	49.50	49.50	49.56
Wt. of Water added to Soil (W3 - W2)	46.30	46.20	46.20	46.23
Wt. of Soil (W2 - W1)	8.80	8.90	8.80	8.88
Wt. of Water displaced by Soil (W4 - W1) - (W3 - W2) = W	3.40	3.30	3.30	3.30
Specific Gravity of Soil Particle (W2 - W1)/W				2.67

Table 4.7b: Specific Gravity of River CHANCHAGA Sand

Bottle No.	1	6	3	Average
Wt. of bottle + water (full) (W4)	89.90	93.40	87.30	90.20
Wt. of bottle + Soil + water (W3)	95.20	98.90	92.60	95.57
Wt. of bottle + Soil (W2)	49.00	52.60	46.40	49.33
Wt. of bottle (W1)	40.20	43.80	37.50	40.50
Wt. of Addition of Water (W4 - W1)	49.70	49.60	49.80	49.70
Wt. of Water added to Soil (W3 - W2)	46.20	46.30	46.20	46.23
Wt. of Soil (W2 - W1)	8.80	8.80	8.90	8.83
Wt. of Water displaced by Soil (W4 - W1) - (W3 - W2) = W	3.50	3.30	3.60	3.47
Specific Gravity of Soil Particle (W2 - W1)/W				2.54

Table 4.7c: Specific Gravity of Imported Sand

Bottle No.		2	4	5	Average
Wt. of bottle + water (full) (W4)		93.25	93.70	88.50	91.82
Wt. of bottle + Soil + water (W3)		98.60	99.25	93.90	97.25
Wt. of bottle + Soil (W2)		52.35	53.00	47.70	51.02
Wt. of bottle (W1)		43.55	44.15	38.85	42.19
Wt. of Addition of Water (W4 - W1)		49.70	49.55	49.65	49.63
Wt. of Water added to Soil (W3 - W2)		46.25	46.25	46.20	46.23
Wt. of Soil (W2 - W1)		8.80	8.85	8.85	8.83
Wt. of Water displaced by Soil (W4 - W1) - (W3 - W2) = W		3.45	3.30	3.45	3.40
Specific Gravity of Soil Particle (W2 - W1)/W					2.60

4.4 Other Physical Properties of the River Sands

Other physical properties of sand from rivers in Nigeria and imported sand are shown in Table 4.8 which indicates that sand from river Benue, CHANCHAGA and the imported sand had a porosity of 42 %, 47 % and 45 % respectively and is within the recommended range value of 35 % to 50 %, reported by [9].

Table 4.8: Other Physical Properties

River Sands	Porosity (%)	Permeability(cm/sec)
River Benue	42	0.47
River CHANCHAGA	47	0.24
Imported Sand	45	0.35

4.5 Filtration Tests

The filtration test results are presented in Tables 4.10 – 4.15.

4.6 Filtrate Quality

The filtrate quality results are presented in Table 4.16 – 4.21.

Table 4.10: Head Loss Development through media with time for River Benue Sand (Filtration Rate = 6.45 m/hr)

Depth(cm) /Time(hr)	0	5	15	30	45	60	75	90	105	120
1	0	0.014	0.073	0.162	0.250	0.338	0.427	0.515	0.603	0.692
2	0	0.440	0.162	0.338	0.515	0.692	0.869	1.045	1.222	1.399
3	0	0.073	0.250	0.515	0.780	1.045	1.310	1.575	1.840	2.105
4	0	0.103	0.338	0.692	1.045	1.399	1.752	2.105	2.459	2.812
5	0	0.132	0.427	0.869	1.310	1.752	2.194	2.636	3.077	3.519
6	0	0.162	0.515	1.045	1.575	2.105	2.636	3.166	3.696	4.226
7	0	0.191	0.603	1.222	1.840	2.459	3.077	3.696	4.314	4.933
8	0	0.221	0.692	1.399	2.105	2.812	3.519	4.226	4.933	5.639
9	0	0.250	0.780	1.575	2.370	3.166	3.961	4.756	5.551	6.346
10	0	0.280	0.869	1.752	2.636	3.519	4.403	5.286	6.170	7.053
11	0	0.309	0.912	1.929	2.901	3.872	4.844	5.816	6.788	7.760
12	0	0.338	1.045	2.105	3.166	4.226	5.286	6.346	7.406	8.467
13	0	0.368	1.134	2.282	3.431	4.579	5.728	6.876	8.025	9.173
14	0	0.397	1.222	2.459	3.696	4.933	6.170	7.406	8.643	9.880
15	0	0.427	1.310	2.636	3.961	5.286	6.611	7.937	9.262	10.587
16	0	0.456	1.399	2.812	4.226	5.639	7.053	8.467	9.880	11.294

Table 4.11: Head Loss Development through media with time for River Benue Sand (Filtration Rate = 9.65 m/hr)

Depth(cm)/Time(hr)	0	5	15	30	45	60	75	90	105	120
1	0	0.031	0.124	0.264	0.403	0.542	0.682	0.821	0.960	1.099
2	0	0.078	0.264	0.542	0.821	1.099	1.378	1.657	1.935	2.214
3	0	0.124	0.403	0.821	1.239	1.657	2.075	2.492	2.910	3.328
4	0	0.171	0.542	1.099	1.657	2.214	2.771	3.328	3.886	4.443
5	0	0.217	0.682	1.378	2.075	2.771	3.468	4.164	4.861	5.557
6	0	0.264	0.821	1.657	2.492	3.328	4.164	5.000	5.836	6.687
7	0	0.310	0.960	1.935	2.910	3.886	4.861	5.836	6.811	7.786
8	0	0.356	1.099	2.214	3.328	4.443	5.557	6.672	7.786	8.901
9	0	0.403	1.239	2.492	3.746	5.000	6.254	7.507	8.761	10.015
10	0	0.449	1.378	2.771	4.164	5.557	6.950	8.343	9.736	11.129
11	0	0.496	1.517	3.050	4.582	6.114	7.647	9.179	10.711	12.244
12	0	0.542	1.657	3.328	5.000	6.672	8.343	10.015	11.687	13.358
13	0	0.589	1.796	3.607	5.418	7.229	9.040	10.851	12.662	14.467

Table 4.12: Head Loss Development through media with time for River CHANCHAGA Sand (Filtration Rate= 6.45 m/hr)

Depth(cm)/Time(hr)	0	5	15	30	45	60	75	90	105	120
1	0	0.034	0.132	0.279	0.427	0.574	0.721	0.868	1.016	1.163
2	0	0.083	0.279	0.574	0.868	1.163	1.457	1.752	2.046	2.341
3	0	0.132	0.427	0.868	1.310	1.752	2.194	2.635	3.077	3.519
4	0	0.181	0.574	1.163	1.752	2.341	2.930	3.519	4.108	4.697
5	0	0.230	0.721	1.457	2.194	2.930	3.666	4.402	5.138	5.875
6	0	0.279	0.868	1.752	2.635	4.000	4.402	5.286	6.169	7.053
7	0	0.329	1.016	2.046	3.077	4.108	5.138	6.169	7.200	8.231
8	0	0.378	1.163	2.341	3.519	4.697	5.875	7.053	8.231	9.408
9	0	0.427	1.310	2.635	3.961	5.286	6.611	7.936	9.261	10.586
10	0	0.476	1.457	2.930	4.402	5.875	7.347	8.819	10.292	11.764
11	0	0.525	1.605	3.224	4.844	6.464	8.083	9.703	11.323	12.942
12	0	0.574	1.752	3.519	5.286	7.053	8.819	10.586	12.353	14.120
13	0	0.623	1.899	3.813	5.727	7.642	9.556	11.470	13.384	15.299
14	0	0.672	2.046	4.108	6.169	8.231	10.292	12.353	14.415	16.476
15	0	0.721	2.194	4.402	6.611	8.819	11.028	13.237	15.445	17.654
16	0	0.770	2.341	4.697	7.053	9.408	11.764	14.120	16.476	18.832

Table 4.13: Head Loss Development through Media with Time River CHANCHAGA Sand. (Filtration Rate = 9.65m/hr)

Depth(cm)/Time(hr)	0	5	15	30	45	60	75	90	105	120
1	0	0.063	0.218	0.450	0.683	0.915	1.148	1.380	1.613	1.845
2	0	0.140	0.450	0.915	1.380	1.845	2.310	2.775	3.240	3.705
3	0	0.218	0.683	1.380	2.078	2.775	3.473	4.170	4.868	5.565
4	0	0.295	0.915	1.845	2.775	3.705	4.635	5.565	6.495	7.425
5	0	0.373	1.148	2.310	3.473	4.635	5.798	6.495	8.123	9.285
6	0	0.450	1.380	2.775	4.170	5.565	6.960	8.355	9.750	11.145
7	0	0.528	1.613	3.240	4.868	6.495	8.123	9.750	11.378	13.005
8	0	0.620	1.845	3.705	5.565	7.425	9.285	11.145	13.005	14.865
9	0	0.683	2.078	4.170	6.263	8.355	10.448	12.540	14.633	16.725
10	0	0.760	2.310	4.635	6.960	9.285	11.610	13.935	16.260	18.585
11	0	0.838	2.565	5.100	7.658	10.215	12.773	15.330	17.888	20.445
12	0	0.915	2.775	5.565	8.355	11.145	13.935	16.725	19.515	22.305
13	0	0.993	3.008	6.030	9.053	12.075	15.098	18.120	21.143	24.165

Table 4.14: Head Loss Development Through media with time for Imported Sand (Filtration Rate = 6.45 m/hr)

Depth(cm)/Time (hr)	0	5	15	30	45	60	75	90	105	120
1	0	0.001	0.06	0.149	0.237	0.325	0.414	0.502	0.59	0.679
2	0	0.427	0.149	0.325	0.502	0.679	0.856	1.032	1.209	1.386
3	0	0.06	0.237	0.502	0.767	1.032	1.297	1.562	1.827	2.092
4	0	0.09	0.325	0.679	1.032	1.386	1.739	2.092	2.446	2.799
5	0	0.119	0.414	0.856	1.297	1.739	2.181	2.623	3.064	3.506
6	0	0.149	0.502	1.032	1.562	2.092	2.623	3.153	3.683	4.213
7	0	0.178	0.59	1.209	1.827	2.446	3.064	3.683	4.301	4.920
8	0	0.208	0.679	1.386	2.092	2.799	3.506	4.213	4.92	5.626
9	0	0.237	0.767	1.562	2.357	3.153	3.948	4.743	5.538	6.333
10	0	0.267	0.856	1.739	2.623	3.506	4.390	5.273	6.157	7.040
11	0	0.296	0.899	1.916	2.888	3.859	4.831	5.803	6.775	7.747
12	0	0.325	1.032	2.092	3.153	4.213	5.273	6.333	7.393	8.454
13	0	0.355	1.121	2.269	3.418	4.566	5.715	6.863	8.012	9.160
14	0	0.384	1.209	2.446	3.683	4.920	6.157	7.393	8.63	9.867
15	0	0.414	1.297	2.623	3.948	5.273	6.598	7.924	9.249	10.574
16	0	0.443	1.386	2.799	4.213	5.626	7.04	8.454	9.867	11.281

Table 4.15: Head Loss Development through media with time for Imported Sand (Filtration Rate = 9.65 m/hr)

Depth(cm)/Time(hr)	0	5	15	30	45	60	75	90	105	120
1	0	0.018	0.111	0.251	0.390	0.529	0.669	0.808	0.947	1.086
2	0	0.065	0.251	0.529	0.808	1.086	1.365	1.644	1.922	2.201
3	0	0.111	0.390	0.808	1.226	1.644	2.062	2.479	2.897	3.315
4	0	0.158	0.529	1.086	1.644	2.201	2.758	3.315	3.873	4.430
5	0	0.204	0.669	1.365	2.062	2.758	3.455	4.151	4.848	5.544
6	0	0.251	0.808	1.644	2.479	3.315	4.151	4.987	5.823	6.674
7	0	0.297	0.947	1.922	2.897	3.873	4.848	5.823	6.798	7.773
8	0	0.343	1.086	2.201	3.315	4.430	5.544	6.659	7.773	8.888

9	0	0.39	1.226	2.479	3.733	4.987	6.241	7.494	8.748	10.002
10	0	0.436	1.365	2.758	4.151	5.544	6.937	8.330	9.723	11.116
11	0	0.483	1.504	3.037	4.569	6.101	7.634	9.166	10.698	12.231
12	0	0.529	1.644	3.315	4.987	6.659	8.330	10.002	11.674	13.345
13	0	0.576	1.783	3.594	5.405	7.216	9.027	10.838	12.649	14.454

Table 4.16: Filtrate Turbidity changes through media with time for River Benue Sand. (Filtration Rate = 6.45 m/hr, Inflow Turbidity = 32 NTU)

Depth(cm)/Time(hr)	5	15	30	45	60	75	90	105	120
1	20.42	15.79	11.92	8.95	6.82	5.20	3.81	2.87	2.04
2	19.66	15.20	11.4	8.56	6.46	4.84	3.66	2.75	2.00
3	19.03	14.72	11.05	8.28	6.19	4.68	3.54	2.63	1.98
4	18.42	14.29	10.73	8.04	6.03	4.57	3.42	2.56	1.96
5	17.85	13.85	10.42	7.81	5.87	4.41	3.30	2.51	1.92
6	17.25	13.42	10.10	7.57	5.67	4.29	3.22	2.43	1.90
7	16.54	12.71	9.63	7.29	5.40	4.05	3.06	2.31	1.88
8	15.99	12.31	9.23	6.94	5.20	3.93	2.95	2.23	1.84
9	15.28	11.68	8.80	6.70	4.96	3.74	2.79	2.12	1.80
10	14.64	11.44	8.60	6.46	4.84	3.62	2.75	2.04	1.76
11	14.56	11.48	8.56	6.41	4.76	3.31	2.66	1.96	1.74
12	14.51	11.46	8.51	6.36	4.71	3.26	2.61	1.86	1.72
13	14.46	11.44	8.46	6.31	4.66	3.21	2.54	1.87	1.71
14	14.95	11.97	9.04	6.74	5.08	3.80	2.83	2.10	1.85
15	15.42	12.29	9.24	6.88	5.20	3.92	2.92	2.20	1.92
16	15.91	12.50	9.47	7.04	5.28	3.96	2.99	2.26	2.01

Table 4.17: Filtrate Turbidity changes through media with time for River Benue Sand. (Filtration Rate = 9.65 m/hr, Inflow Turbidity = 32 NTU)

Depth(cm)/Time(hr)	5	15	30	45	60	75	90	105	120
1	20.85	16.38	12.51	9.55	7.41	5.79	4.41	3.64	2.59
2	19.86	15.79	12.00	9.15	7.06	5.51	4.25	3.34	2.51
3	19.39	15.16	11.64	8.87	6.78	5.28	4.13	3.22	2.47
4	18.56	14.88	11.32	8.64	6.46	5.16	4.01	3.14	2.39
5	18.08	14.45	10.97	8.36	6.31	4.96	3.85	3.06	2.31
6	17.41	13.93	10.53	8.16	6.19	4.88	3.74	2.91	2.23
7	16.78	13.26	10.06	7.81	5.99	4.64	3.62	2.79	2.19
8	16.19	12.75	9.70	7.53	5.75	4.49	3.54	2.71	2.15
9	16.61	13.21	9.93	7.59	5.75	4.54	3.56	2.80	2.32
10	17.06	13.7	10.29	7.79	5.87	4.58	3.63	2.92	2.44
11	17.32	13.77	10.32	7.95	6.27	4.90	3.90	3.11	2.59
12	17.78	14.12	10.78	8.04	6.37	5.06	3.95	3.17	2.62
13	17.86	14.47	10.63	8.18	6.41	5.18	4.00	3.25	2.79

Table 4.18: Filtrate Turbidity changes through media with time for River CHANCHAGA Sand (Filtration Rate = 6.45 m/hr; Inflow Turbidity = 32 NTU)

Depth(cm)/Time(hr)	5	15	30	45	60	75	90	105	120
1	21.97	17.35	13.47	10.51	8.38	6.76	5.37	4.42	3.59
2	21.22	16.76	12.96	10.51	8.02	6.40	5.21	4.30	3.55
3	20.71	16.28	12.61	10.12	7.74	6.24	5.10	4.19	3.51
4	19.96	15.85	12.29	9.84	7.59	6.12	4.98	4.11	3.47
5	19.40	15.41	11.97	9.60	7.43	5.96	4.86	4.03	3.44
6	18.81	14.98	11.62	9.36	7.23	5.85	4.78	3.95	3.44
7	17.82	14.27	11.18	9.13	6.95	5.61	4.62	3.87	3.44
8	17.55	13.87	10.79	8.85	6.76	5.49	4.50	3.79	3.40
9	16.83	13.24	10.35	8.26	6.52	5.29	4.34	3.69	3.36
10	16.20	13.00	10.12	8.02	6.40	5.17	4.27	3.59	3.32
11	16.16	12.98	10.08	7.98	6.38	5.10	4.22	3.57	3.28
12	16.08	12.94	10.04	7.95	6.33	5.08	4.18	3.53	3.24
13	16.03	12.88	9.99	7.88	6.28	5.06	4.16	3.48	3.22
14	16.53	13.55	10.61	8.32	6.66	5.25	4.32	3.64	3.42
15	17.02	13.88	9.75	8.47	6.79	5.47	4.47	3.74	3.52
16	17.14	14.11	11.09	8.65	6.89	5.58	4.65	3.87	3.62

Table 4.19: Filtrate Turbidity changes through media with time for River CHANCHAGA Sand.
(Filtration Rate = 9.65 m/hr ; Inflow Turbidity = 32 NTU)

Depth(cm)/Time(hr)	5	15	30	45	60	75	90	105	120
1	22.57	17.94	14.03	10.98	8.89	7.35	5.93	4.94	4.15
2	21.74	17.35	13.44	10.47	8.61	6.99	5.73	4.82	4.07
3	21.22	16.8	13.16	10.43	8.30	6.83	5.65	4.74	4.03
4	20.55	16.44	12.84	10.19	8.18	6.72	5.57	4.70	3.99
5	18.69	16.00	12.57	9.96	8.02	6.56	5.45	4.62	3.91
6	17.43	15.57	12.21	9.68	7.82	6.44	5.33	4.54	3.83
7	16.64	14.86	11.78	9.44	7.55	6.20	5.21	4.46	3.75
8	15.77	14.46	11.38	9.09	7.35	6.08	5.10	4.38	3.71
9	16.10	14.78	11.68	9.42	7.55	6.23	5.21	4.53	3.81
10	16.38	15.06	12.11	9.70	7.76	6.38	5.38	4.61	3.93
11	16.70	15.53	12.26	9.72	7.92	6.50	5.43	4.65	3.97
12	17.12	15.91	12.64	10.01	8.12	6.70	5.70	4.85	4.01
13	17.27	16.21	12.82	10.21	8.10	6.71	5.66	4.90	4.18

Table 4.20: Filtrate Turbidity Changes through media with time for Imported Sand
(Filtration Rate = 6.45 m/hr; Inflow Turbidity = 38 NTU)

Depth(cm)/Time(hr)	5	15	30	45	60	75	90	105	120
1	19.54	14.91	11.04	8.07	5.94	4.32	2.93	1.99	1.16
2	18.78	14.32	10.52	7.68	5.58	3.96	2.78	1.87	1.12
3	18.15	13.84	10.17	7.40	5.31	3.80	2.66	1.75	1.10
4	17.54	13.41	9.85	7.16	5.15	3.69	2.54	1.68	1.08
5	16.97	12.97	9.54	6.93	4.99	3.53	2.42	1.63	1.04
6	16.37	12.54	9.22	6.69	4.79	3.41	2.34	1.55	1.02
7	15.66	11.83	8.75	6.41	4.52	3.17	2.18	1.43	1.00
8	15.11	11.43	8.35	6.06	4.32	3.05	2.07	1.35	0.96
9	14.40	10.80	7.92	5.82	4.08	2.86	1.91	1.24	0.92
10	13.76	10.56	7.72	5.58	3.96	2.74	1.87	1.16	0.88
11	13.68	10.60	7.68	5.53	3.88	2.43	1.78	1.08	0.86
12	13.63	10.58	7.63	5.48	3.83	2.38	1.73	0.98	0.84
13	13.58	10.56	7.58	5.43	3.78	2.33	1.66	0.99	0.83
14	14.07	11.09	8.16	5.86	4.20	2.92	1.95	1.22	0.97
15	14.54	11.41	8.36	6.00	4.32	3.04	2.04	1.32	1.04
16	15.03	11.62	8.59	6.16	4.40	3.08	2.11	1.38	1.13

Table 4.21: Filtrate Turbidity changes through media with time for Imported Sand
(Filtration Rate = 9.65 m/hr; Inflow Turbidity = 38 NTU)

Depth(cm)/Time(hr)	5	15	30	45	60	75	90	105	120
1	20.18	15.71	11.84	8.88	6.74	5.12	3.74	2.97	1.92
2	19.19	15.12	11.33	8.48	6.39	4.84	3.58	2.67	1.84
3	18.72	14.49	10.97	8.20	6.11	4.61	3.46	2.55	1.80
4	17.89	14.21	10.65	7.97	5.79	4.49	3.34	2.47	1.72
5	17.41	13.78	10.3	7.69	5.64	4.29	3.18	2.39	1.64
6	16.74	13.26	9.86	7.49	5.52	4.21	3.07	2.24	1.56
7	16.11	12.59	9.39	7.14	5.32	3.97	2.95	2.12	1.52
8	15.52	12.08	9.03	6.86	5.08	3.82	2.87	2.04	1.48
9	15.94	12.54	9.26	6.92	5.08	3.87	2.89	2.13	1.65
10	16.39	13.03	9.62	7.12	5.20	3.91	2.96	2.25	1.77
11	16.65	13.10	9.65	7.28	5.60	4.23	3.23	2.44	1.92
12	17.11	13.45	10.11	7.37	5.70	4.39	3.28	2.50	1.95
13	17.19	13.8	9.96	7.51	5.74	4.51	3.33	2.58	2.12

4.7 Backwash Results

The backwash results are presented in Table 4.22 – 4.24 all at backwash rate of 45.9 m/hr and these plotted at (Appendix E); Figure 4.22 – 4.24

Table 4.22: River Benue Sand, Bed expansion = 25.8%

Backwash Time (min)	0.5	1	1.5	2	3	4	5	6	7	8	10	12	15
Waste Turbidity (NTU)	15	34	375	230	64	36	21	20	18	17	17	17	17

Table 4.23: River CHANCHAGA Sand, (Bed Expansion = 26.5 %)

Backwash Time (min)	0.5	1	1.5	2	3	4	5	6	7	8	10	12	15
Waste Turbidity(NTU)	19	41	397	280	70	35	26	22	19	18	18	18	18

Table 4.24: Imported Sand (Bed Expansion = 22.2 %)

Backwash Time (min)	0.5	1	1.5	2	3	4	5	6	7	8	10	12	15
Waste Turbidity(NTU)	12	28	365	210	54	33	18	19	16	15	14	14	14

Particle Size Distribution: The effective size and uniformity coefficient of river Benue, CHANCHAGA and that of the imported sand are quite close indicating that their grain size range is almost similar as shown in Table F (Appendix F), which is within the recommended values for filter media ([10], [11]). This suggests their performance in water treatment might produce close results. ([10], [11]) [23] recommended that effective sizes of value greater than 0.75 mm and uniformity coefficient of 1.6 is to be used for river jewo sand in orire Local Government Area of oyo state and also [24] also recommended range of 0.35 – 1.00 for effective sizes and uniformity coefficient of 1.2 – 1.8 for Yola and shelleng sand to be used as filter media. [4] suggested uniformity co-efficient of 1.9 which is differ from the universal Uniformity Co-efficient of 1.3 – 1.8.

Acid Solubility: The low acid solubility results from the acid solubility test carried out indicate that, the level of hydrogen carbonate or calcium carbonate of river sands from Benue, CHANCHAGA and the imported sand have values within the recommended range value of acid solubility of 1–2 % [11] as show in Table 4.5. This indicate that; imported sand from Brazil, river Benue and CHANCHAGA sands have a low hydrogen carbonate content of 0.85 %, 1.05 % and 1.70 % respectively.

Specific Gravity: The specific gravity of individual filter grains is one of several factors important in determining the rate of water flow to achieve a certain bed expansion during backwashing at a given water temperature. It is also one of several factors that determine the rate at which media grains settle after backwashing. In systems where combined air scour and water washing takes place over a weir it determines the size of stilling zone adjacent to the weir necessary to reduce media losses [25].

The average specific gravity for each of the samples is presented in Tables 4.7a – 4.7c. The specific gravity of sands from river Benue, CHANCHAGA and the imported sand from Brazil have specific gravity of 2.67, 2.54 and 2.60 respectively which are higher than that of water and are within the recommended value greater than 2.50. The specific gravity parameter is an indication that during backwashing of the filter media, they will require more critical fluidization velocity or force for bed expansion. It becomes more difficult to separate the particulate, since it is collected over water during this process.

Other Physical Properties: The physical properties of sands from river Benue, CHANCHAGA and imported sand falls within the recommended value for sand filter as shown in Table 4.8. Summary of the other physical properties are shown in Appendix F; Table F. The porosity and permeability parameters are very important in the choice of a suitable filtering material. This is because if permeability is too high, no meaningful filtration can take place and if too low, the bed gets easily clogged and it becomes uneconomical to operate since it will require frequent backwashing.

Head Loss Development: Filtration rate (hydraulic loading) can influence the performance of a filter bed due to several factors. An increase in volume of flow per unit time gives an increase in weight of the material deposited in the filter pores. The use of higher flow rate produces a greater pressure drop across the clean filters and a greater drop per unit of material deposited, if this is evenly distributed through the filter bed. The change in velocity within the filter bed can alter the removal of the particles and the distribution of deposits in the bed, and hence influence the removal capacity and efficiency.

As shown in summary Table G in Appendix G respectively. [26], recommended head loss of 1.8 m because at head loss of 2 m or more is when floc break through was noticed and [4] also recommended maximum head loss of 2.8 m for Kaduna river.

The imported sand from Brazil shows a slightly lower rate of head loss increase which was also fairly uniform throughout the filter run. This may be due to the relatively uniform in nature of the sample particles resulting from grading and chemical treatment of the sand. These factors ensure that floc penetrates the entire media bed more uniformly, thereby keeping surface deposition minimal.

Filter Run Time: The filter run times can be measured either through the attainment of maximum design head loss or by the deterioration of the quality to an unacceptable level as stated by [27].

For the high filtration rates used and for the turbidity loading used, the result obtained for the filter run time are quite significant and very encouraging. 16 hours of operation at a filtration rate of 6.45 m/hr for the two river sands and imported sand with an inflow turbidity loading of 32 NTU and 38 NTU respectively. The e

influent turbidity were 2.01NTU, 3.62 NTU and 1.13NTU for river Benue, CHANCHAGA and imported sand respectively as shown in Tables 4.16, 4.18 and 4.20 while at 13 hour of operation at a higher rate of 9.65 m/hr, the effluent turbidity were 2.79 NTU, 4.18 NTU and 2.12 NTU respectively as shown in Tables 4.17, 4.19 and 4.21. These values of sands from river Benue, CHANCHAGA and imported sand from Brazil are well below the WHO maximum permissible level of 5.00 NTU. Filter run times should not be more less than 12 hours and more than 24 hours was recommended by [28] to reduce labour needed to run the plant, also [4] recommended 16 hours at rates of 6.25 m/hr and 22 hours for turbidity load of 10 NTU.

It can be observed that an increase in the hydraulic loading rate resulted to reduction of filter running time. This shows that the hydraulic loading rate is inversely proportional to filter running time.

Backwashing: As already mentioned in (Filter run times), maximum head loss attainment determined the termination of filter runs and therefore the commencement of filter cleaning (backwashing). Table 4.22 – 4.24 show that a backwash rate of 45.9 m/hr was adequate for all sands. However, while the river Benue and CHANCHAGA sand produced expansions of 25.8 % and 26.5 % respectively, the imported sand from Brazil produced a slightly lower expansion of 22.2 % at this backwash rate. At 10 minutes river Benue, CHANCHAGA sand and imported sand from Brazil has waste turbidity of 17 NTU, 18 NTU and 14 NTU respectively after backwashing at a backwash rate of 45.9 m/hr which indicates that all the impurities could not be washed out through backwashing alone.

Although these expansion values border on the lower limits of recommended expansion of between 20 - 50 % [20], he also found a back wash rate of 37.5 to 50 m/hr are adequate for satisfactory cleaning. [29] suggested an optimum back wash rate of 41.75 m/hr with a small expansion of 16 – 18 % and back wash duration of 6 -12 minutes. While [4] using local sand (Kaduna river) recommended 40 m/hr and duration of 10 minute to reduce quantity of clear water usage. [24] recommended 42.9 m/hr and expansion of 20 – 50 %. It is believed that a slightly higher rate of backwashing will expand the bed sufficiently to enable better washing. A better washing of the filter media could be achieved by providing for surface wash or through air scour prior to backwash.

V. Conclusions and Recommendations

From the results of the study research conducted, the following conclusions and recommendations were drawn:

- River Benue and CHANCHAGA sands show good physical and chemical properties as filter media.
- If properly graded to recommended standards of effective size and uniformity coefficient, the sands studies would perform better.
- A filter had depth of 120 cm was found adequate.
- Filter washing time of ten (10) minute was found to be adequate at the backwash rate of 45.9 m/hr without surface wash or air scour and produced an expansion of filter bed within recommended limits of 20 – 50 %.

The following recommendation were made from the study carried

- An effective size of 0.45 mm and uniformity coefficient of 1.8 is recommended for these river sands. This will ensure the use of over 50 % of the stock samples as filter media.
- It is recommended that normal filtration rates of between 6 m/hr – 10 m/hr be applied when using these sands to avoid rapid clogging, thereby leading to uneconomical washing intervals.
- Surface wash air scour prior to backwash when using these sands, is recommended. This will greatly improve the washing of the sand media at the backwash rate of 45.9 m/hr with filter bed expansion of between 20 – 50 %. Alternatively, the backwash rate could be raised slightly to increase the fluidization of the bed, so that particles have a greater chance of rubbing against one another in increased motion.
- More studies into other sources of sand to discover their performance as filter media should be encouraged.

Acknowledgements

We will like to use this medium to acknowledge Prof. Charles Amen Okuofu of the department of Water resources and environmental engineering, Amadu Bello University, Zaria. Whose advice and direction was invaluable throughout the period of this research. It is also pertinent to appreciate the head of department of soil science and land resources management, federal university, Wukari, Taraba State, Dr Tanimu Joseph whose correction and criticism did not go unhelpful throughout the duration of the research.

Finally, we thank the members of staff in the department of soil science and land resources management, Federal University, Wukari, especially the technologists who did not leave us throughout our research. We owe so much to you.

References

- [1]. T. A. Zondi, B. M. Brouckaert P. Pillay, M. J. Pryorl, and A. Amirtharajah. Assessment of the use of Autonomous Valve less filters for Turbidity Removal in Rural Applications. Proceedings of the WISA Biennial Conference and Exhibition, Durban, 19-23 May, 2002.
- [2]. S. O. Adeyemi. "Local Materials as Filter Media" Proceedings of the 6th WEDC Conference, Water and Wastewater Engineering in Africa, 1980, pp. 153 – 156
- [3]. E. D. Schroeder. Water and Wastewater Treatment. Mc-Graw Hill, U.S.A. 1971, pp. 167-171
- [4]. S. O. Adeyemi, "Development of Design and Operating Specification for Local Sand as Filtration Media" Nigeria Journal of Engineering Vol.2, N0 5. 1984, pp. 16 – 28
- [5]. M. A. Boller and M. C. Kavanaugh. Particle Characteristics and Head loss Increase in Granular Media Filtration. Water Research. 29(4): 1139-1149, 1995
- [6]. F. Amini and H. V. Troung. Effect of Filter Media Particle Size Distribution on Filtration Efficiency. *Water Quality Research Journal of Environ. Eng. Div. ASCE*. 104(5), 1998, pp.917- 998.
- [7]. American Society for Testing Materials. (ASTM) C33-02a Standard Specification for Concrete Aggregates. West Conshohocken, PA. New Delhi: Tata McGraw-Hill. 2002, pp. 11.
- [8]. H. L. Ball. Optimizing the Performance of Sand Filters and Packed Bed Filter through Media Selection and Dosing Methods. In Proceedings Ninth Northwest water Treatment Short Course, College of Engineering, University of Washington, Seattle, WA. 1997, Pp.205-213.
- [9]. K. J. Ives. "Testing of Filter media". *Jour. Water Supply Research and Technology- Aqua*, 39(3): 144-151, 1990.
- [10]. G. L. Culp and R. L. Culp. New Concepts in Water Purification. Van no strand reinhold company, New York. 1974
- [11]. World Health Organisation (WHO). Guidelines of drinking Water Quality, WHO, Geneva. 2004
- [12]. R. J. M. De Wiest and S. N. Davis, S. N. Porosity and Permeability of Natural Materials Flow Through Porous Media. New York, Academic Press, 1969, Pp. 53-89.
- [13]. A. Y. Sangodoyin. "Assessment of the Filterability Number", M.Sc Project Report in Water Resources Technology, Department of Civil Engineering University of Birmingham. 1981
- [14]. American Water Works Association (AWWA). Water Quality and Treatment, a handbook for community Water Supply AWWA 4th Edition McGraw-Hill Inc Newyork city, 1990. all pages.
- [15]. American Society for Testing and Material (ASTM) E11-01, Standard Test Method for Sieve Analysis of Fine and Coarse Aggregates, ASTM, Philadelphia. New Delhi: Tata McGraw-Hill. 2001,
- [16]. M. Nelkon. Principles of Physics 7th Edition, C.S.S Bookshops and Hart-Davis Education Ltd, Lagos, Nigeria. 1990, pp. 67-78
- [17]. G. Smethurst. Basic Water Treatment for Application, World Wild Scientific publishers', New Delhi. 1986, pp. 134-137
- [18]. American Public Health Association – American water Works Association - Water Environmental Federation APHA – AWWA – WEF, Standard Methods for Examination of Water and Waste Water, 18th edn., Arnold E.G., Lenore S.C and Andrew D.E., (eds.), 1992
- [19]. H. S. Peavy. Environmental Engineering (McGraw-Hill Series in Water Resources and Environmental Engineering) 1985, pp 134 – 153
- [20]. A. Amirtharaja and J. L. Cleasby. "Predicting Expansion of Filter during Backwashing". *Journal of American Water works Association* Vol. 64, 1972, Pp 52 – 59.
- [21]. HACH, DR/2010 HACH Spectrophotometer Procedures Manual, Hach Co. USA, 1998, pp 455-460. 641-700, 767-773.
- [22]. A. G. Knight. Measurement of Turbidity, *Journal of Institute of Water Engineering*. Pp. 34-37, 1980
- [23]. I. A. Oke. "Filtration property of River Jewo Sand (Orire Local Government Area of Oya State)", Unpublished B.Eng. Project, Department of Water Resources and Environmental Engineering, ABU, Zaria. 1995
- [24]. R. Zinas. The Suitability of Yola and Shelling Sands as Filter Media. Unpublished M.Sc Thesis, Department of Water Resources and Environmental Engineering, ABU, Zaria. 1990
- [25]. R. J. Otis. Filter Clogging Mechanisms and Control. Proceedings of the Fourth National Symposiums on individual and Small Community Sewage Systems. ASAE. St. Joseph MI. 1985. Pp. 238-250.
- [26]. S. Kawamura. "Design and operation of high rate filters" *Part 1, 2 and 3 Journal of American Water Works Association* Vol. 67. 1975. pp 34-23
- [27]. M. M. Converse, J. C. Converse and E. J. Tyler. Sand Filter Evaluation in a Northern Climate. In: NOWRA 1999 Conference Proceedings of NOWRA: New Ideas for a New Millennium, Jekyll Island, GA. 1999, Pp. 201-21
- [28]. H. E. Jr. Hudson. Water Clarification processes: Practical Design and Evaluation. New York. Van Nostrand Reinhold Company International London, 1981.
- [29]. R. L. Johnson and J. L. Cleasby. "Effect of Backwash of filter Effluent Quality" *Journal of sanitary Engineering Division A.S.C.E* Vol. 92. 1966

APPENDIX A

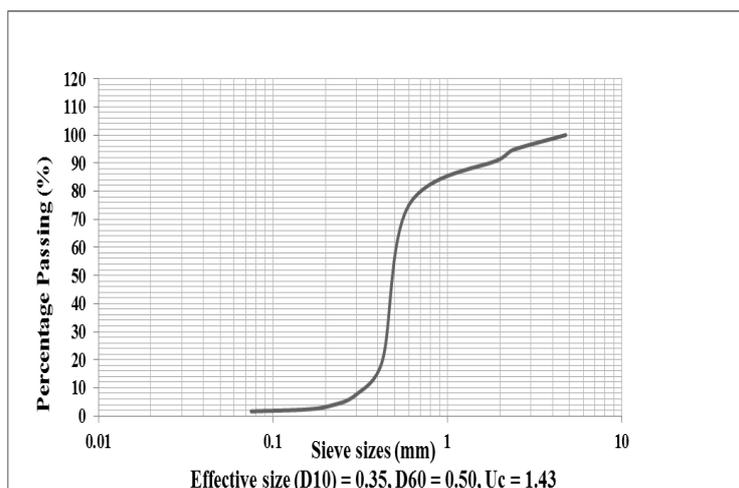


Figure 4.1: Particle Size Distribution of River Benue Sand.

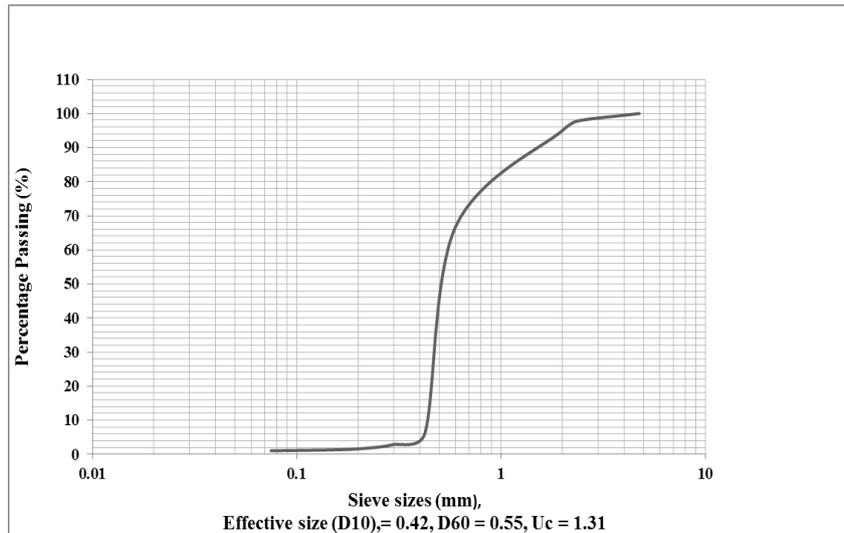


Figure 4.2: Particle Size Distribution of River CHANCHAGA Sand

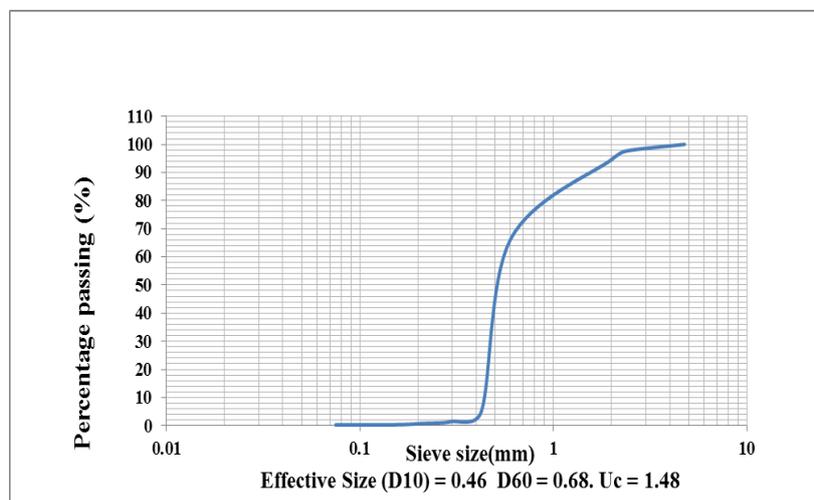


Figure 4.3: Particle Size Distribution of Imported Sand.

Appendix E

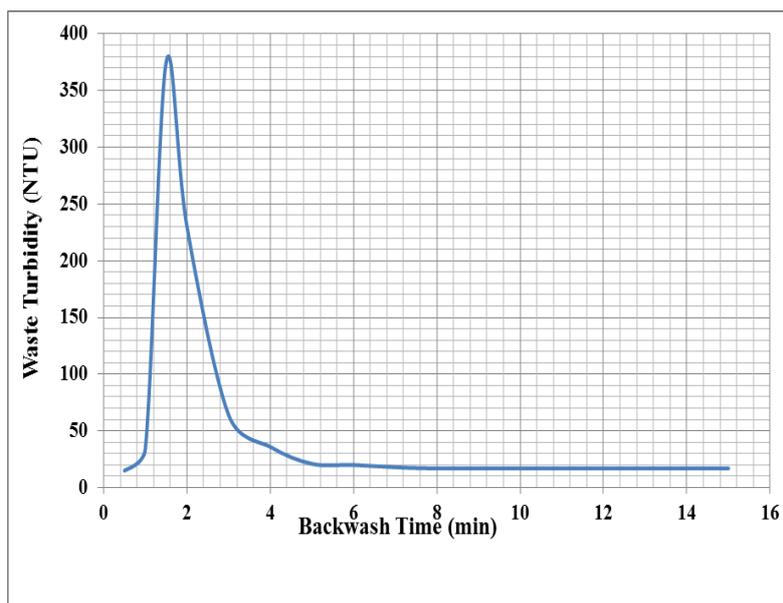


Figure 4.22: River Benue Sand Bed Expansion at 25.8 %, Backwash Rate = 45.9 m/hr

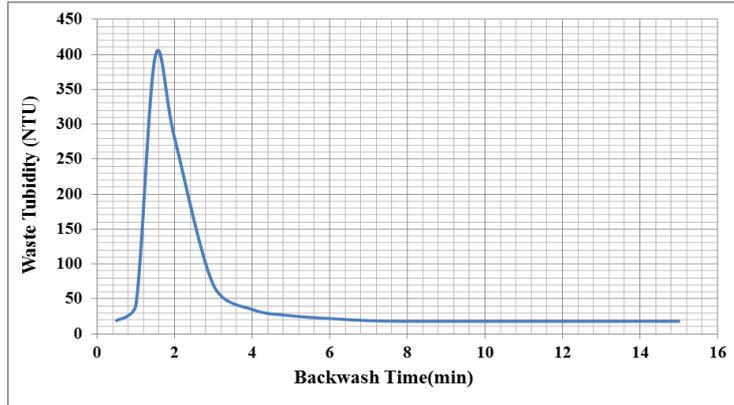


Figure 4.23: River CHANCHAGA Sand Bed Expansion at 26.5 %, Backwash Rate = 45.9 m/hr

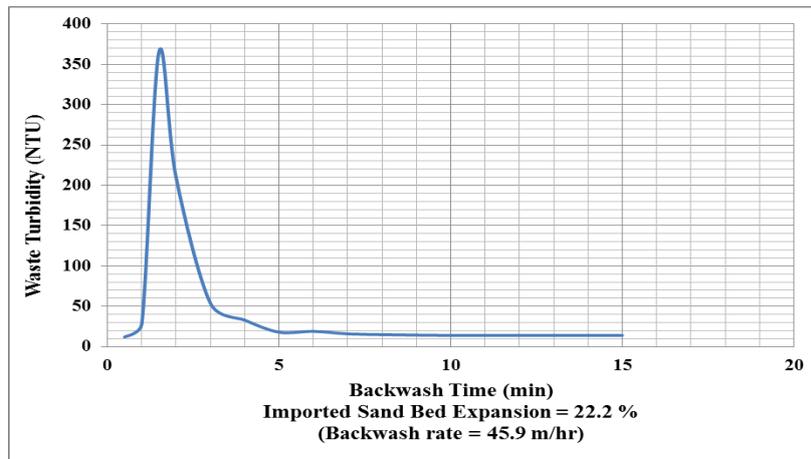


Figure 4.24: Imported Sand Bed Expansion at 22.2 %, Backwash Rate = 45.9 m/hr

Appendix F

River Sands	Effective Sizes (mm)	Uniformity Coefficient (U_c)	Acid Solubility (%)	Specific Gravity	Porosity (%)	Permeability (cm/sec)
River Benue	0.35	1.43	1.05	2.67	42	4.7×10^{-1}
River Chanchaga	0.42	1.31	1.70	2.54	47	2.4×10^{-1}
Imported Sand	0.46	1.48	0.85	2.60	45	3.5×10^{-1}
Recommended	0.35 -1.00	1.3 - 1.8	< 2	>2.5	35 - 50	$10^{-1} - 10^{-3}$

Appendix G

Table G: Summary Table of Filtration Tests (Head Loss Development, (cm))

River Sands	Rate = 6.45 m/hr, Run Time = 16 hrs	Rate = 9.65 m/hr, Run Time = 13 hrs
River Benue	11.294	14.467
River CHANCHAGA	18.832	24.165
Imported Sand	11.281	14.454

Appendix H

Table H: Summary Table of Filtrate Quality (Filtrate Turbidity, (NTU))

River Sands	Inflow Turbidity = 32NTU	
	Rate = 6.45 m/hr, Run Time = 16 hrs	Rate = 9.65 m/hr, Run Time = 13 hrs
River Benue	2.01	2.79
River CHANCHAGA	3.62	4.18
Imported Sand	1.13	2.12